


01 FIRST FLOOR PLAN
1/8" = 1'-0"



02 MEZZANINE FLOOR PLAN
1/8" = 1'-0"

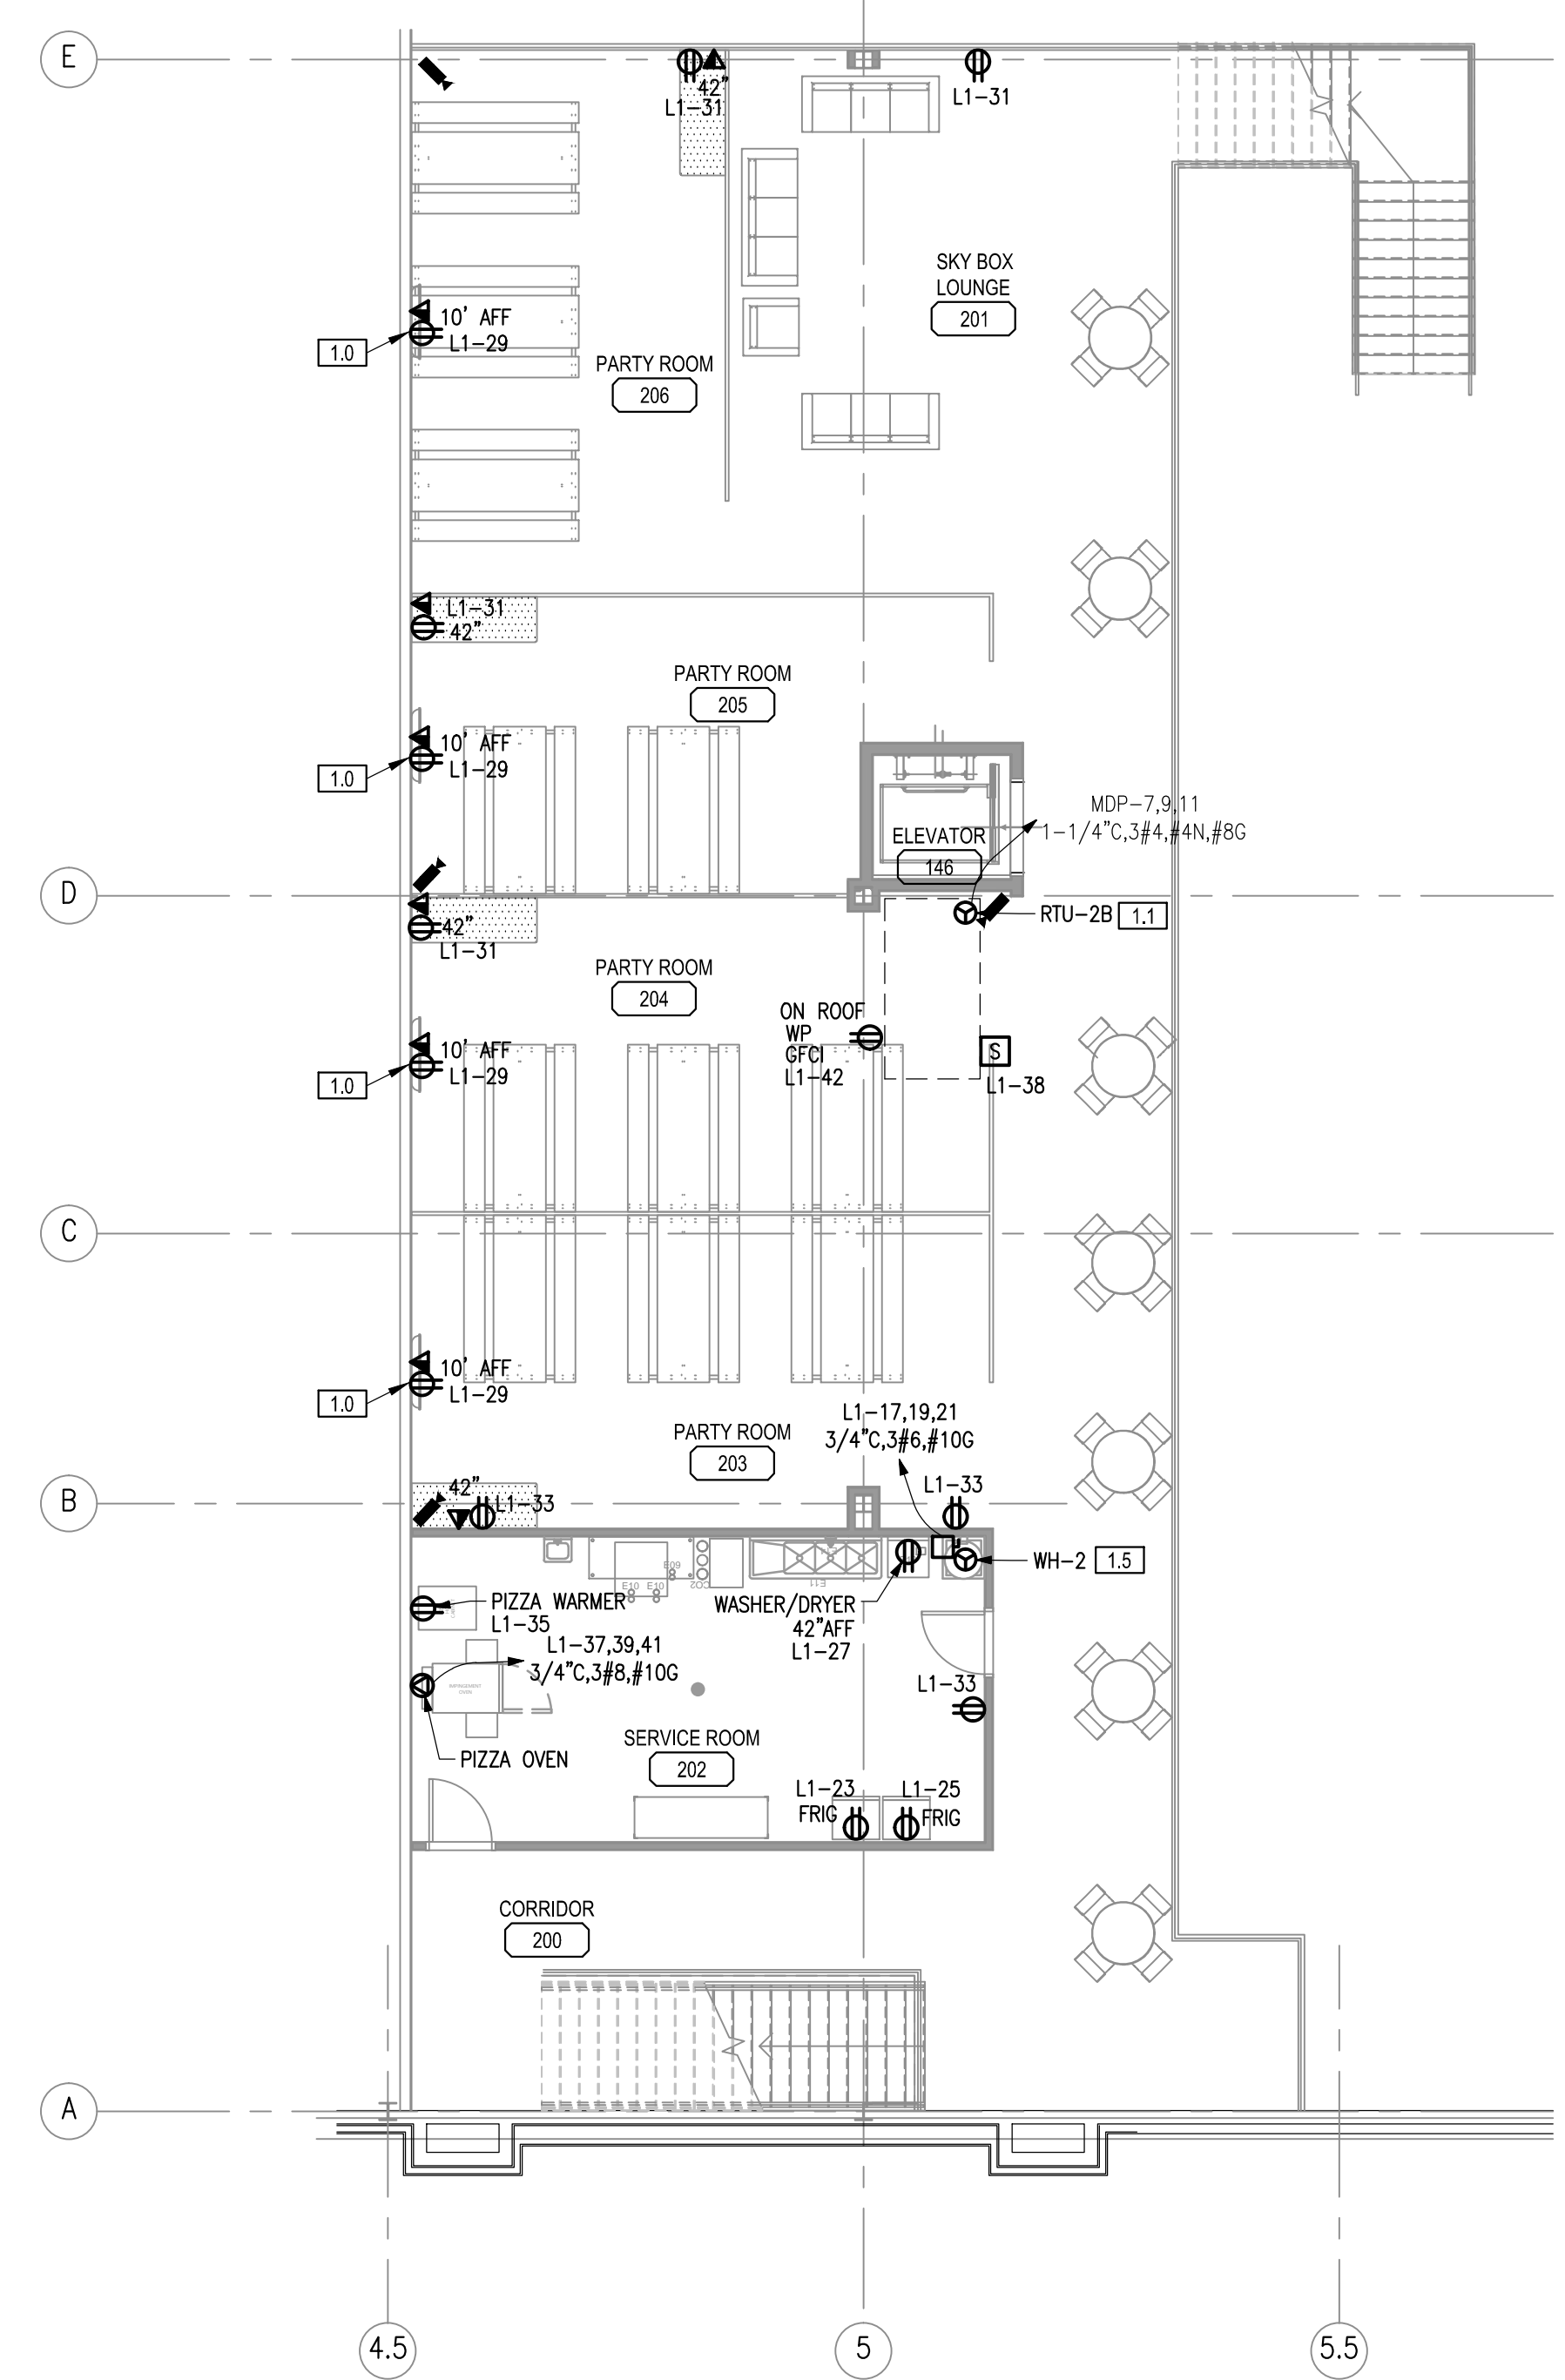

FLOOR PLAN KEYNOTES

- 1.0 COORDINATE LOCATIONS OF ALL DEVICE BOXES WITH EQUIPMENT MFR AND WITH ARCHITECTURAL DRAWINGS/ELEVATIONS PRIOR TO ROUGH-IN.
- 1.1 RTU PROVIDED AND INSTALLED BY LANDLORD BENEATH SEPARATE PERMIT
- 1.2 EXHAUST FAN CONTROLLED BY ROOM LIGHTING OCCUPANCY SENSOR.
- 1.3 FIELD VERIFY ALL EXISTING ELEVATOR EQUIPMENT PROVIDED AND PROVIDE POWER CONNECTIONS AS REQUIRED. COORDINATE CONNECTION TYPE, AUXILIARY CONTACTS, AND ALL REQUIRED CONNECTIONS WITH ELEVATOR MFR PRIOR TO ROUGH-IN.
- 1.5 PROVIDE DISCONNECT AND CONNECTION TO EQUIPMENT.

POWER AND SIGNAL NOTES


1. IF ANY OUTLETS CANNOT BE INSTALLED AS NOTED OR AS SHOWN ON PLANS DUE TO CONFLICTS WITH STRUCTURAL, MECHANICAL OR ELECTRICAL CONDITIONS, CLARIFY WITH OWNER AND/OR SKY ZONE FRANCHISE GROUP AND ARCHITECT BEFORE PROCEEDING WITH OUTLETS IN QUESTION OR RELATED OUTLETS IN AREA.
2. FOR CIRCUITING INFORMATION, PULL BOX LOCATIONS AND CONDUIT SIZES, REFER TO ENGINEERED DRAWINGS. ARCHITECTURAL SPACE PLAN DRAWINGS (DESIGN PACKAGES) GOVERN OUTLET LOCATIONS. VERIFY ANY DISCREPANCIES WITH ARCHITECT.
3. WHEN OUTLETS ARE GROUPED TOGETHER, THEY SHALL BE NO MORE THAN 2" APART. GANGS WITH COMMON FACEPLATE WHENEVER POSSIBLE.
4. NON-DIMENSIONED OUTLETS SHALL BE LOCATED AT THE NEAREST STUD. ALL OUTLET DIMENSIONS ARE TO BE CENTERLINE U.N.O.
5. ALL WALL OUTLETS TO BE MOUNTED AT +18" A.F.F. TO CENTERLINE OF RECEPTACLE, U.N.O. (SEE TYPICAL POWER AND SIGNAL LOCATIONS DIAGRAM).
6. ALL NEW CIRCUITS SHALL BE LABELED ON THE PROPER BUILDING ELECTRICAL PANEL DIRECTORIES.
7. PROVIDE ONE-HOUR PROTECTION AT ALL OUTLETS AND SWITCHES LOCATED IN ONE-HOUR RATED PARTITIONS (AT APPLICABLE CONSTRUCTION).
8. ALL ISOLATED GROUND RECEPTACLES SHALL BE ORANGE WITH WHITE COVER PLATES. (SEE LEGEND FOR COLOR OF RECEPTACLES THROUGHOUT).
9. ALL TELEPHONE AND DATA COVERPLATES TO BE SUPPLIED AND INSTALLED BY TENANT. THEY SHALL BE SIMILAR OR EXACT IN COLOR AND APPEARANCE TO DUPLEX/SWITCH COVERPLATES.
10. TELEPHONE AND DATA CABLE TO BE PLENUM RATED AND SUPPORTED INDEPENDENT FROM SUSPENDED CEILING. ALL TELEPHONE AND DATA CABLES TO BE PROVIDED AND INSTALLED BY TENANT AND/OR TENANT'S VENDOR.
11. TENANT'S TELEPHONE/DATA CONTRACTORS SHALL COORDINATE WORK WITH GENERAL CONTRACTOR.
12. CONDUIT ABOVE CEILING TO BE SELF-SUPPORTED AND HELD TIGHT TO STRUCTURE A MINIMUM OF 6" ABOVE GRID.
13. ALL CONDUIT RUNS ABOVE CEILING SHALL BE DESIGNED TO MEET CODE REQUIREMENTS.
14. CONTRACTOR TO MARK LOCATIONS OF ALL FLOOR MOUNTED RECEPTACLES AND RECEIVE APPROVAL BY ARCHITECT PRIOR TO PROCEEDING WITH CORING.
15. WHERE ELECTRICAL WORK IS SPECIFIED IN CONJUNCTION WITH CASEWORK AND/OR MILLWORK, LAMPS AND FIXTURES ARE TO BE PROVIDED BY GENERAL CONTRACTOR. CUT OUTS FOR SWITCHES, OUTLETS, ETC. SHALL BE PROVIDED BY THE CASEWORK/MILLWORK CONTRACTOR AND SHALL BE COORDINATED WITH THE ELECTRICAL CONTRACTOR, U.N.O.
16. FURNITURE SYSTEM TO BE SUPPLIED AND INSTALLED BY TENANT. ELECTRICAL CONTRACTOR TO MAKE FINAL HARDWIRED CONNECTION AND SUBMIT FOR ALL REQUIRED PERMITS.
17. SCHEDULE THE CORING OF ANY FLOOR OUTLETS WITH BUILDING OWNER TO PREVENT DISTURBANCE OR DAMAGE TO OTHER TENANT SPACES.
18. PROVIDE CONNECTION TO ALL 120V DUCT MOUNTED SMOKE DETECTORS AS REQUIRED.

ELEC & LOW VOLTAGE NOTES

- ELECTRICAL**
- 3 TO 4 OUTLETS MOUNTED AT +17" A.F.F. FOR COURT AREA CLOCKS
 - 1 OUTLET MOUNTED AT +18" A.F.F. FOR CHECK IN AREA CLOCK
 - 1 OUTLET MOUNTED AT 7" A.F.F. OR OTHERWISE NOTED AT ENTRANCE FOR NEON 'OPEN SIGN'
 - 2 OUTLETS MOUNTED AT 76" A.F.F. ON BACK WALL OF SKYBOX STORAGE CASEWORK FOR TV'S
 - 1 OUTLET IN EACH PARTY ROOM MOUNTED AT 66" AFF FOR TV
 - 1 TO 4 OUTLETS MOUNTED AT 10' A.F.F. ON COLUMNS/WALLS, OR AT CEILING HEIGHT FOR HDTV'S
 - 1 TO 2 OUTLETS BEHIND COURTS IN WORK AREA
 - ELECTRICAL HOOKUP FOR COURT DROP DOWN DIVIDER (OPTIONAL)
 - ELECTRICAL HOOKUP FOR EXTERIOR SIGN. CONFIRM REQUIREMENTS AND PLACEMENT WITH SIGN VENDOR
 - OPTIONAL OUTLET AT CEILING HEIGHT IN COURT AREA FOR A FUTURE PROJECTOR TV
- LOW VOLTAGE**
- WIRING FOR SECURITY & COURT VIEWING CAMERAS TO BE COORDINATED WITH VENDOR.
 - WIRING FOR SPEAKERS- 162 WIRE FOR DISTANCES UNDER 300 FT
 - WIRING FOR TV'S- RG-6 COAXIAL CABLE OR S-VIDEO COAXIAL CABLE
 - WIRING FOR COURT PROJECTOR (OPTIONAL)

POWER AND SIGNAL LEGEND

	<p>TYPE: DUPLEX OUTLET POWER: 120V, 20 AMP MOUNTING: 18" A.F.F., U.N.O. COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES:</p>
	<p>TYPE: FOURPLEX OUTLET POWER: 120V, 20 AMP MOUNTING: 18" A.F.F., U.N.O. COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES: PROVIDE & INSTALL GFI ONLY WHERE NOTED.</p>
	<p>TYPE: DEDICATED DUPLEX OUTLET POWER: 120V, 20 AMP, SEPARATE CIRCUIT MOUNTING: 18" A.F.F., U.N.O. COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES:</p>
	<p>TYPE: DEDICATED FOURPLEX OUTLET POWER: 120V, 20 AMP, SEPARATE CIRCUIT MOUNTING: 18" A.F.F., U.N.O. COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES:</p>
	<p>TYPE: DUPLEX OUTLET POWER: 220V, 30 AMP MOUNTING: 18" A.F.F., U.N.O. COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES: NEMA 1 60R RECEPTACLE</p>
	<p>TYPE: FLUSH FLOOR MOUNTED J-BOX AND TEL/DATA OUTLET POWER: (4) 20 AMP CIRCUITS, MAX. 8 DUPLEX OUTLETS PER CIRCUIT MOUNTING: FLOOR MOUNTED COLOR: BLACK TRIM NOTES: PROVIDE CONDUIT FOR TELE/DATA ACCESS</p>
	<p>TYPE: FOURPLEX AND TEL/DATA OUTLET POWER: FOURPLEX OUTLET MOUNTING: FLUSH FLOOR MOUNTED COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES: PROVIDE (2) 1" CONDUITS TO NEAREST WALL/STUB 6" ABOVE WALL IN PLENUM SPACE. PROVIDE PULL STRING.</p>
	<p>TYPE: J-BOX POWER: (4) 20 AMP CIRCUITS, MAX. 8 DUPLEX OUTLETS PER CIRCUIT MOUNTING: 18" A.F.F., U.N.O. COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES: PROVIDE 2" CONDUIT STUBBED 6" ABOVE CEILING. PROVIDE RING AND PULL STRING.</p>
	<p>TYPE: TELEPHONE/ DATA OUTLET POWER: N/A MOUNTING: 18" A.F.F., U.N.O. COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES: 2 S BOX SIZE. PROVIDE RING AND PULL STRING. (COVERPLATE BY TENANT'S VENDOR)</p>
	<p>TYPE: DATA OUTLET POWER: N/A MOUNTING: 18" A.F.F., U.N.O. COLOR: BLACK, UNLESS OTHERWISE NOTED NOTES: 2 S BOX SIZE. PROVIDE RING AND PULL STRING. (COVERPLATE BY TENANT'S VENDOR)</p>
	<p>SWITCH: 20A/POLE SPECIFICATION GRADE TOGGLE SWITCH COLOR: BLACK, UNLESS OTHERWISE NOTED OS = OCCUPANCY SENSOR, SPECIFICATION GRADE, TYPICAL OF LEVITON 05510-IDE</p>
	<p>EQUIPMENT CONNECTION</p>
	<p>DUCT MOUNTED SMOKE DETECTOR. PROVIDE 120V AS REQUIRED.</p>
	<p>SECURITY CAMERA- WIRING NOT TO EXCEED 180' TO DVR / SERVER NOTE: DO NOT MOUNT DIRECTING TO METAL SURFACE, BECAUSE CAUSES DISTORTION.</p>
	<p>+X-X" - DENOTES MOUNTING HEIGHT AS NOTED R - DENOTES RECESSED RECEPTACLE</p>

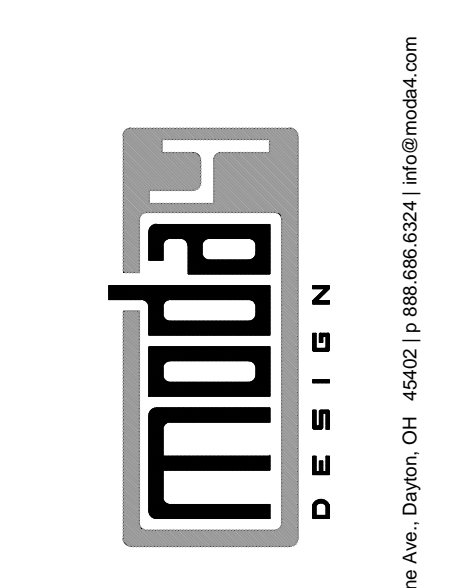

Interior Renovation for
Sky Zone - Indoor Trampoline Park
Orland Park
66 Orland Square Drive
Orland Park, IL 60462
Tenant Suite B
MODA4 PROJECT NUMBER: 15023

ISSUED / REVISED	DATE
OWNER REVIEW	07.15.15
ISSUED FOR PERMIT	07.18.15

Electrical
Power Floor
Plans